


INSTRUCTIONS CM305C

© Panduit Corp. 2007

Installation Instructions (CRTW):

Center rack top trough on the top of a standard 19" EIA rack. Align mounting holes of the trough and Mounting Bracket. Secure with (4) #12-24 screws.

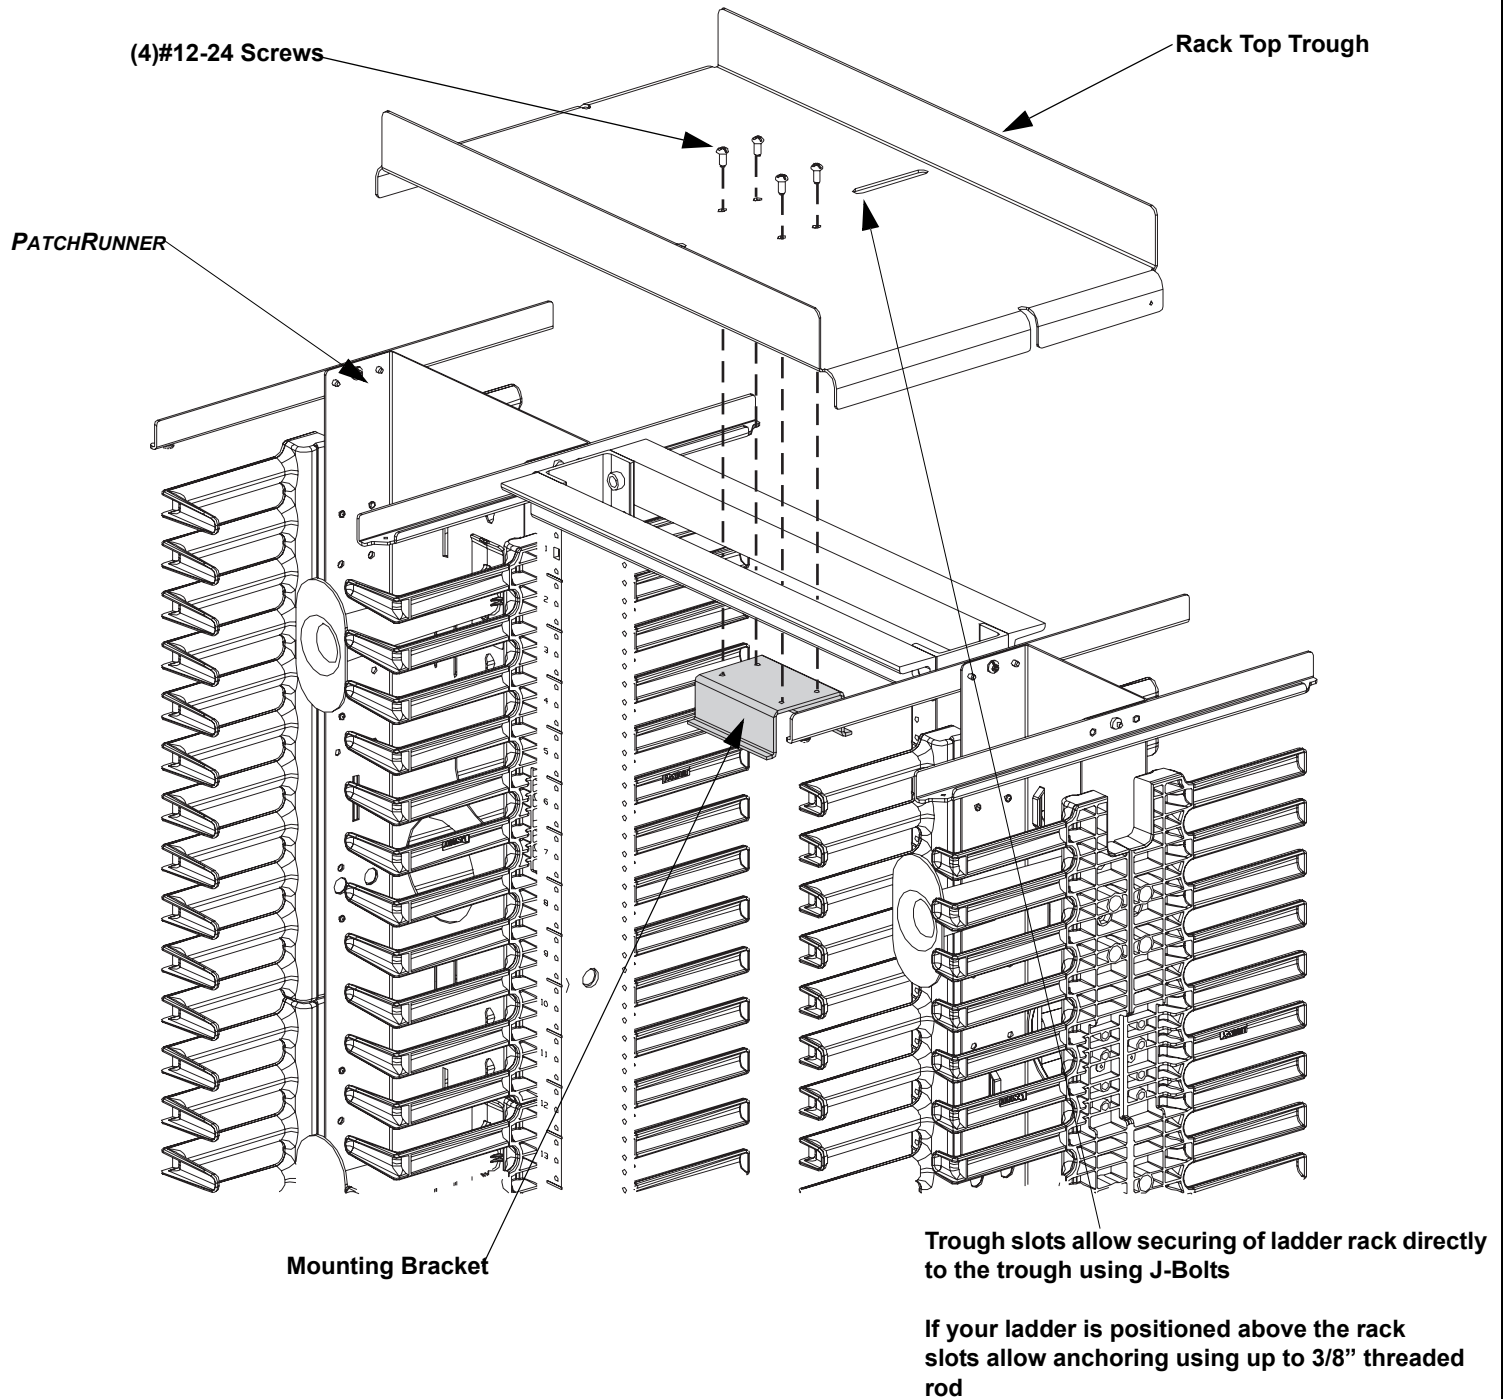

INSTRUCTIONS CM305C

© Panduit Corp. 2007

Installation Instructions (WMPV45ERTW):

Center rack top trough on the top of a standard 19" EIA rack. Align mounting holes of the trough and Mounting Bracket. Secure with (4) #12-24 screws.

Tie-Down slots provide access points for ties used to bundle routed cables together

Front slots must be used when mounting with WMPV* products.

NETRUNNER

(4)#12-24 Screws

Rack Top Trough

Rear slots must be used when mounting with NRV* products (not shown).

Mounting Bracket

Trough slots allow securing of ladder rack directly to the trough using J-Bolts

If your ladder is positioned above the rack slots allow anchoring using up to 3/8" threaded rod